

Installation and Assembly Instructions

Excursion (EXN) Series

WARNING

Risk of fire, electric shock, injury or property damage

Risk of electric shock--Disconnect power to equipment before installing or servicing.
 This equipment must be installed according to all applicable codes & ordinances.
 Installation and service of this equipment must be performed by qualified service personnel.
 Do not install damaged equipment.
 Read these instructions before installing, servicing or maintaining this equipment.
 Save these instructions for maintaining and servicing.




CAUTION

Failure to follow instructions or altering equipment could result in damage and void warranty.
 Edges may cut--wear gloves while handling or servicing this equipment.
 Inspect equipment for damage from shipping and handling.

LUMINAIRE PREPARATION

1. Remove the luminaire from the carton and inspect luminaire for damage. Do not install a damaged luminaire.
2. Identify which model has been ordered and determine mounting method--pendant or direct mount--for appropriate mounting instructions see appropriate section.

WIRING INFORMATION

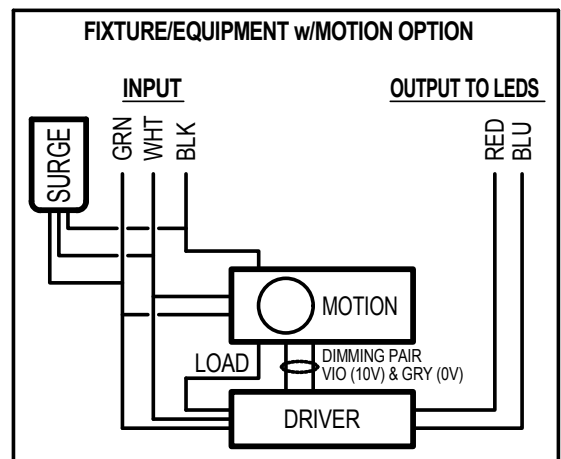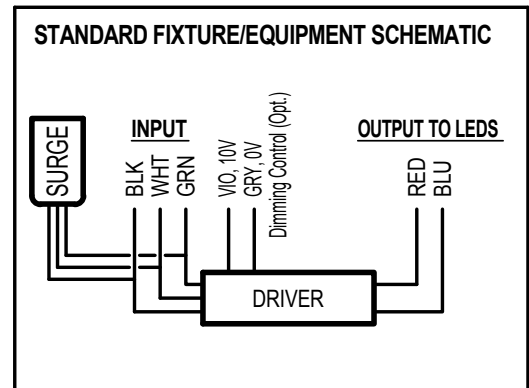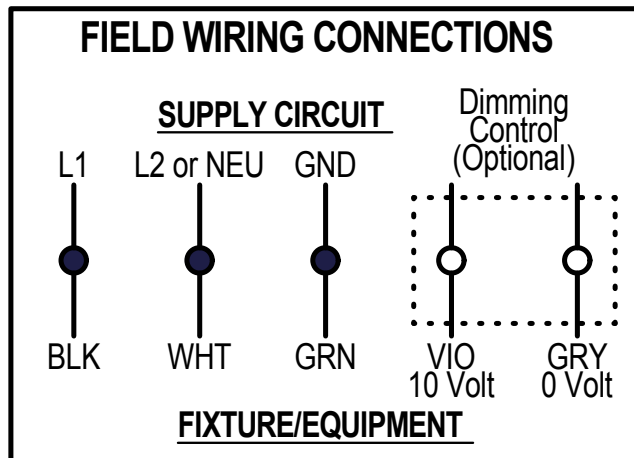

Installation Questions
 Call LSI Field Service Dept.
 800-436-7800 ext. 3300


LSI Industries Inc. 10000 Alliance Rd. Cincinnati, OH 45242
 www.lsi-industries.com
 671822 Rev. 03-07-18

Installation and Assembly Instructions

Excursion (EXN) Series

Steps for Direct Mounting


1. Remove j-box plate from luminaire and attach to junction box (junction box and fasteners provided by others).
2. Hang fixture from j-box plate in preparation for wiring.
3. Make wiring connections and position wire nut branch connections inside junction box.
4. Swing fixture closed and tighten two fasteners completing fixture installation.

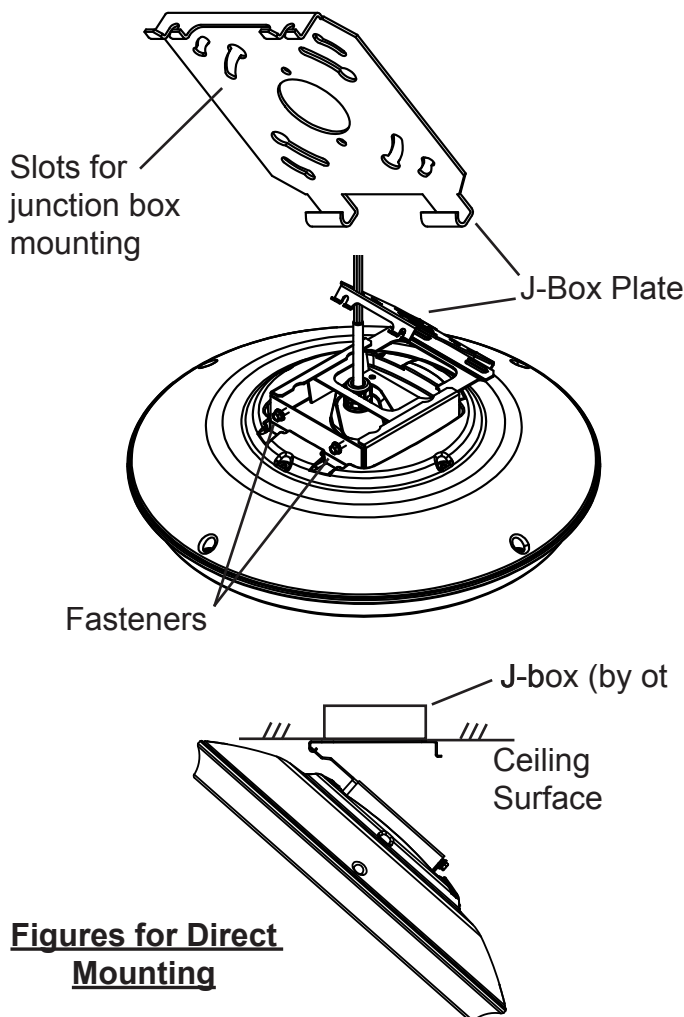

Figures for Direct Mounting

Steps for Pendant Mounting

1. Luminaire is provided with a 3/4" threaded hub for pendant hanging. Materials for pendant hanging provided by others.
2. Feed wires through 3/4" conduit (provided by others). Thread and tighten conduit into 3/4" hub. Tighten set screw located in 3/4" threaded hub securing conduit to 3/4" threaded hub.
3. Pendant or Conduit Hanging from junction box determined and provided by others.
4. Wiring connections made in junction box provided by others.

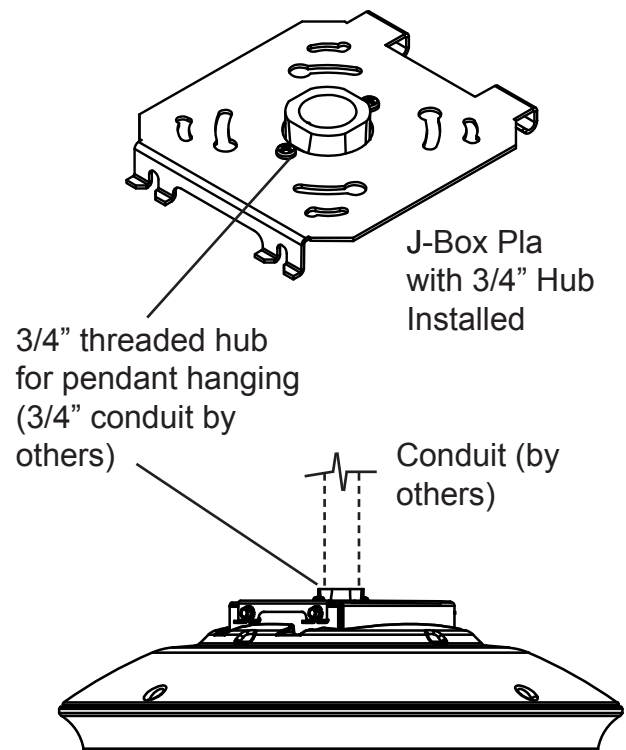

Figures for Pendant Mounting

Installation Questions
Call LSI Field Service Dept.
800-436-7800 ext. 3300

LSI Industries Inc. 10000 Alliance Rd. Cincinnati, OH 45242
www.lsi-industries.com
671822 Rev. 03-07-18